


2006 Emergency Services Agreement

- Agreement executed in 2006; expires in 2031
- Conveyance ability completed in 2009; system has been utilized approximately 5 times
- Provides for up to 50 cfs of emergency groundwater to be exchanged with imported water, not to exceed 30 days in duration per emergency
- OC Water Reliability Study identified emergency needs for SOC beyond 2030
- IRWD is currently evaluating their system capability to extend the agreement beyond 2030
- Other options might be possible

IRWD Interconnection Project Phase 1

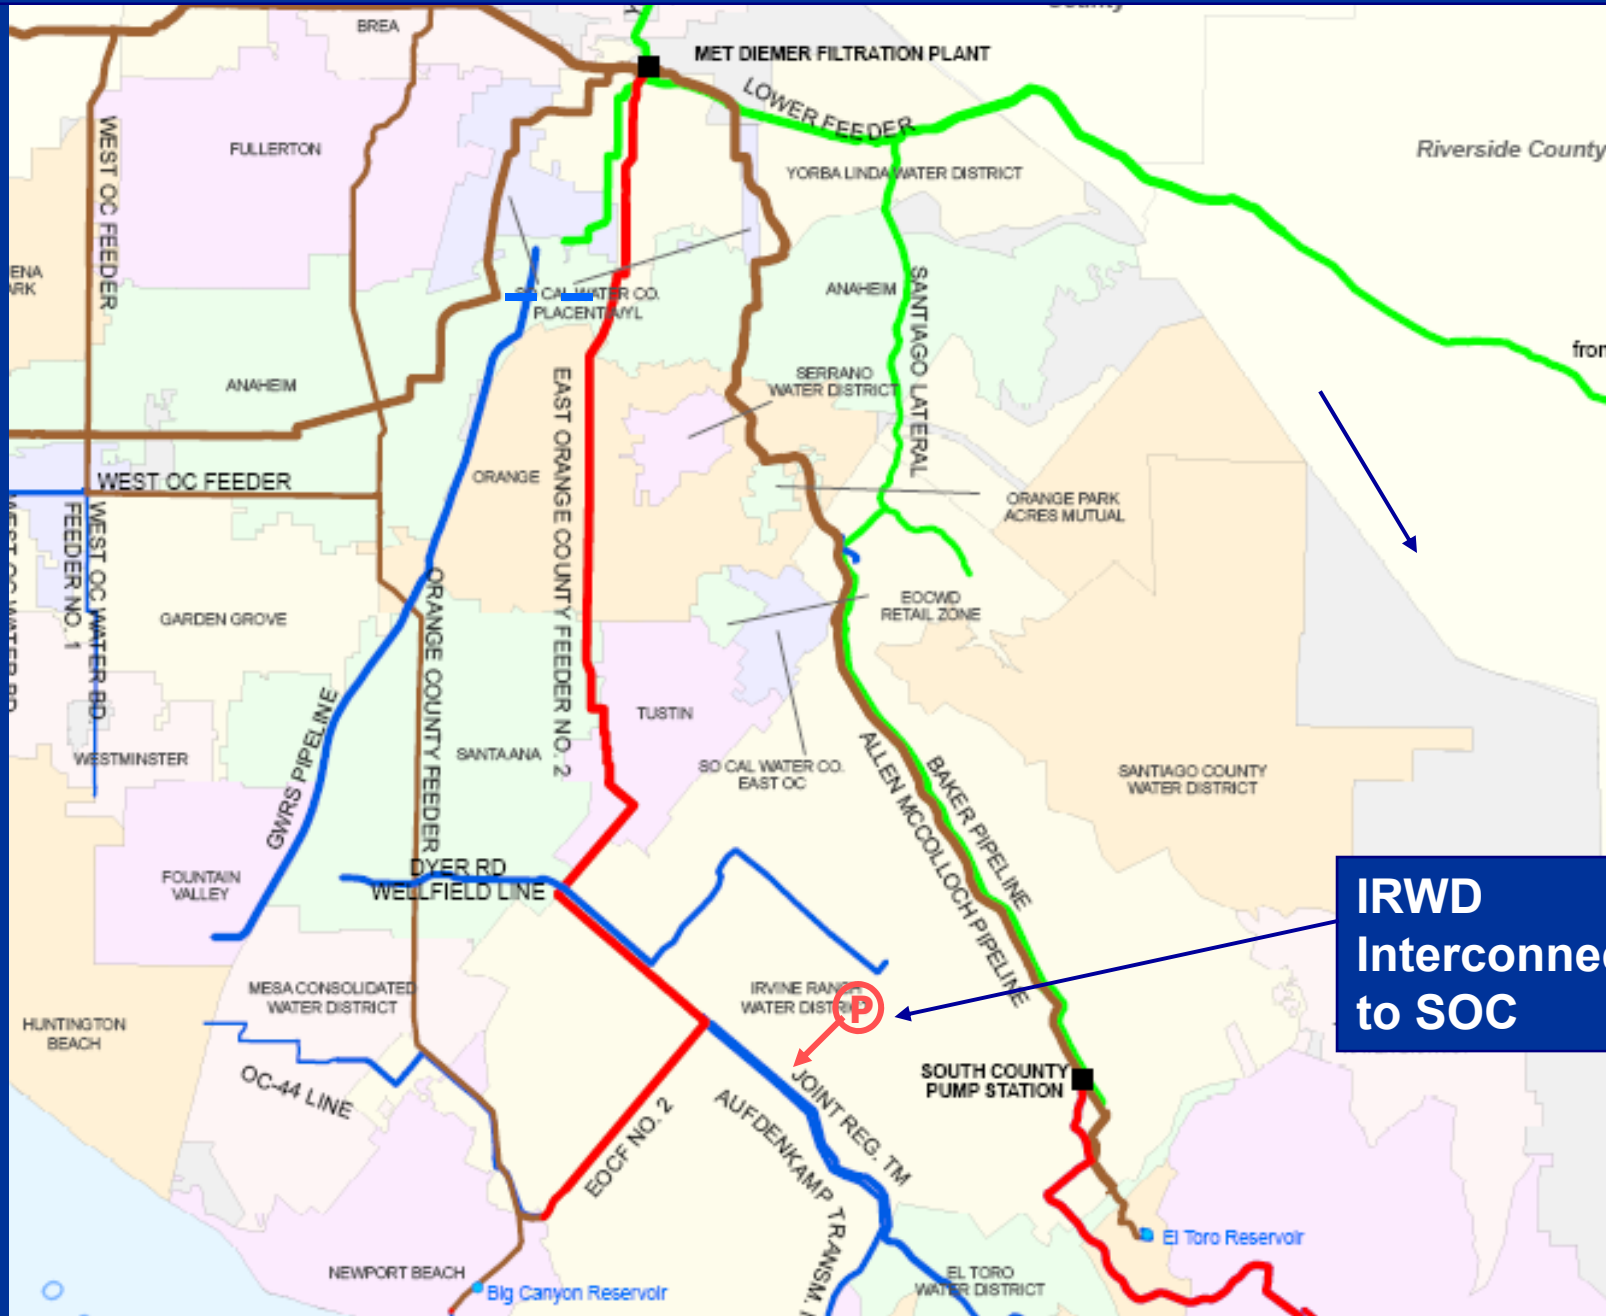

**IRWD
Interconnection
to SOC**